

NOTE
DIMENSIONS IN [] ARE INCH EQUIVALENTS.

REV	DATE	ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL	BY	UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE:
-	10-24-11	NEW DRAWING [92089-1]	DDH	X.XX ±
A	3-1-12	(B-4) LOW VOLTAGE & HIGH VOLTAGE LEADS SHOWN [CT05555]	VPP	X.X ±
B	5-30-12	SEE SHEET 3 OF 4. [CT14992]	GFR	ANGLES ±
C	3-1-13	SEE SHEET 4 [CT39030]	SVP	
D	4-16-13	SEE SHEET 4 [CT43845]	SVP	

APPROVALS	DATE
DDH	10-24-11
DDH	10-24-11
JJN	10-24-11

KOHLER CO. METRIC PRO-E
POWER SYSTEMS, KOHLER, WI 53044 U.S.A.
THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.


TITLE: **DIMENSION PRINT**

SCALE: 0.16 CAD NO. SHEET 1 of 4
DWG NO. **ADV-8424** D

14/20RESA



AIR INLET

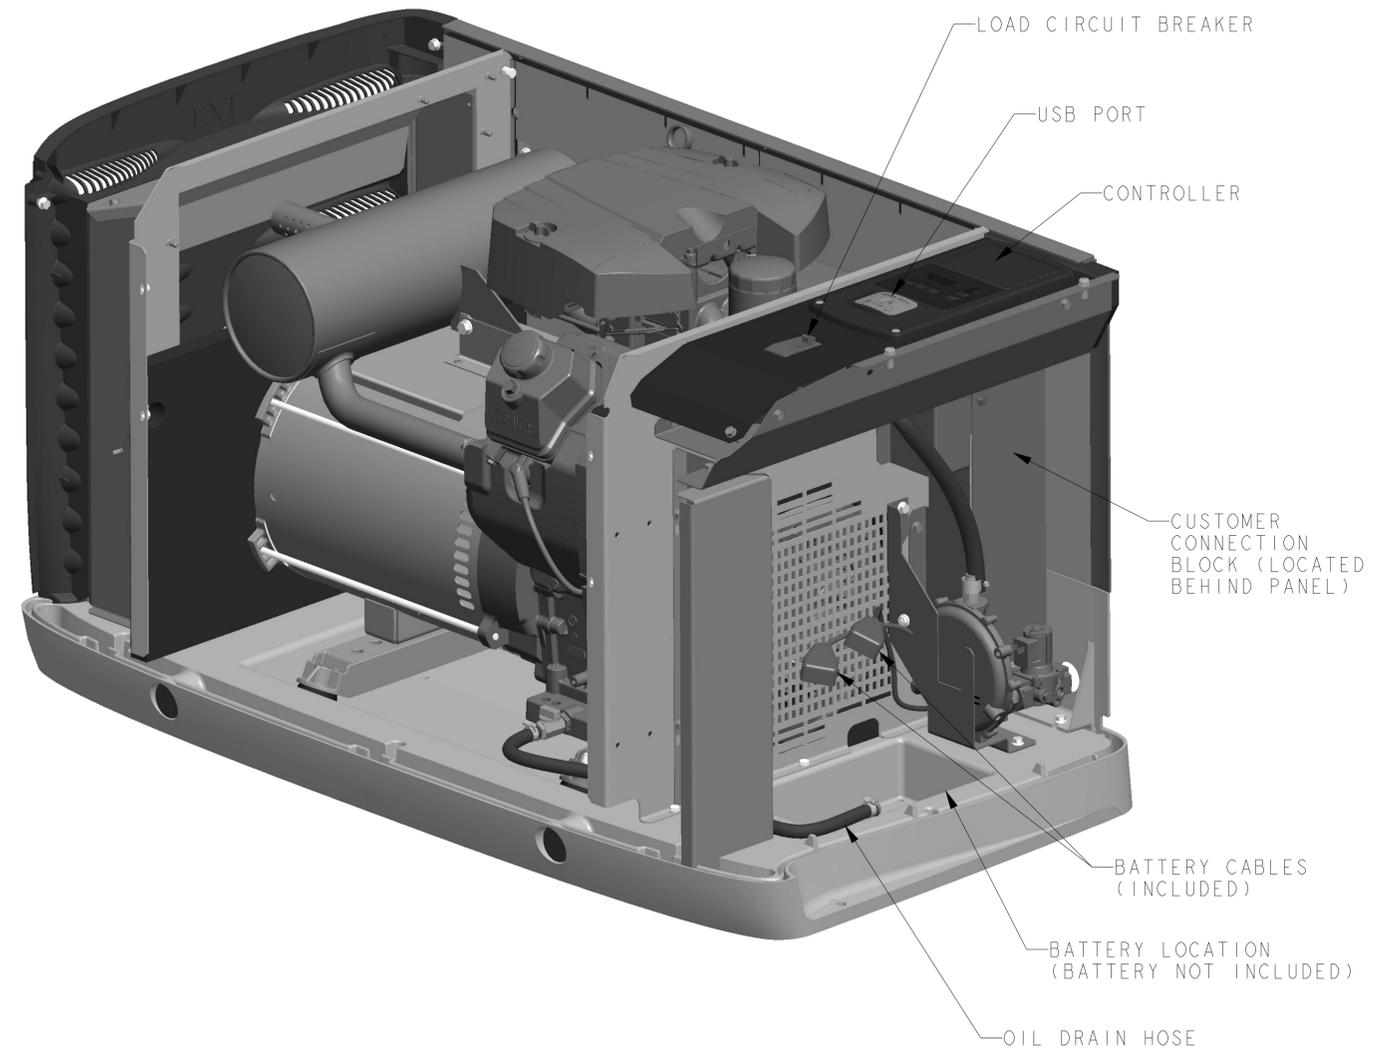

LOAD CIRCUIT BREAKER

USB PORT

CONTROLLER

CUSTOMER CONNECTION BLOCK (LOCATED BEHIND PANEL)





BATTERY CABLES (INCLUDED)

BATTERY LOCATION (BATTERY NOT INCLUDED)

OIL DRAIN HOSE

REV	DATE	ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL	BY	UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE:	COHLEK CO. METRIC PRO-E
-	10-24-11	NEW DRAWING [92089-1]	DDH	X.XX ±	POWER SYSTEMS, KOHLER, WI 53044 U.S.A. THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. TITLE: DIMENSION PRINT SCALE: 0.25 CAD NO. SHEET 3 of 4 DWG NO.: ADV-8424 D
A	3-1-12	SEE SHEET 1 [CT05555]	VPP	X.X ±	
B	5-30-12	(C-2) USB PORT WAS FUSES & USB PORT. [CT14992]	GFR	ANGLES ±	
C	3-1-13	SEE SHEET 4 [CT39030]	SVP	THIRD ANGLE PROJECTION	
D	4-16-13	SEE SHEET 4 [CT43845]	SVP		
			APPROVALS	DATE	
			DRAWN	DDH	10-24-11
			CHECKED	DDH	10-24-11
			APPROVED	JJN	10-24-11

14/20RESA

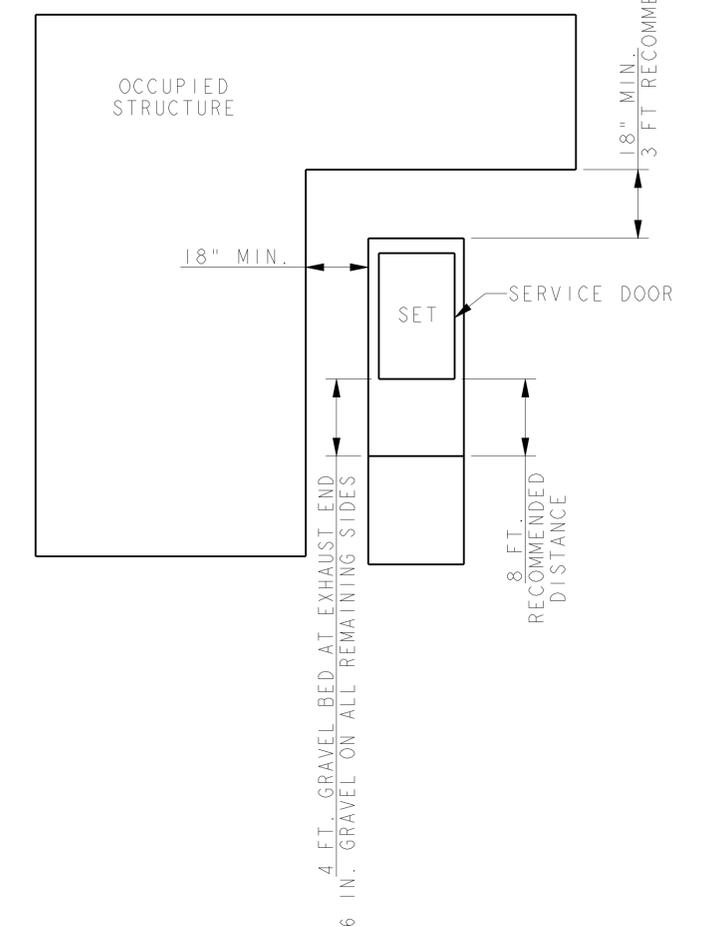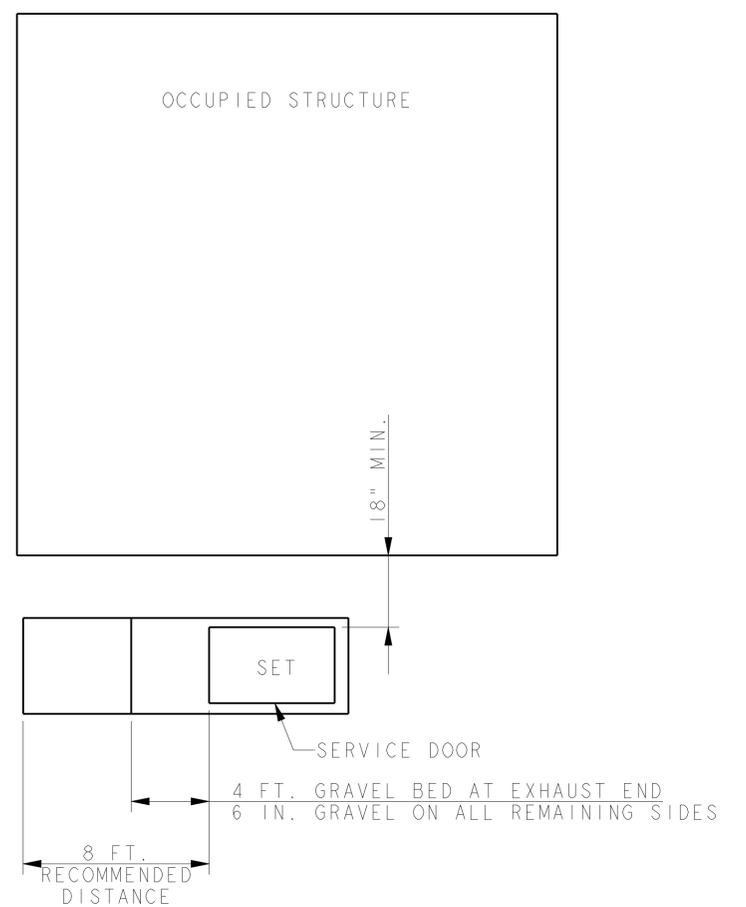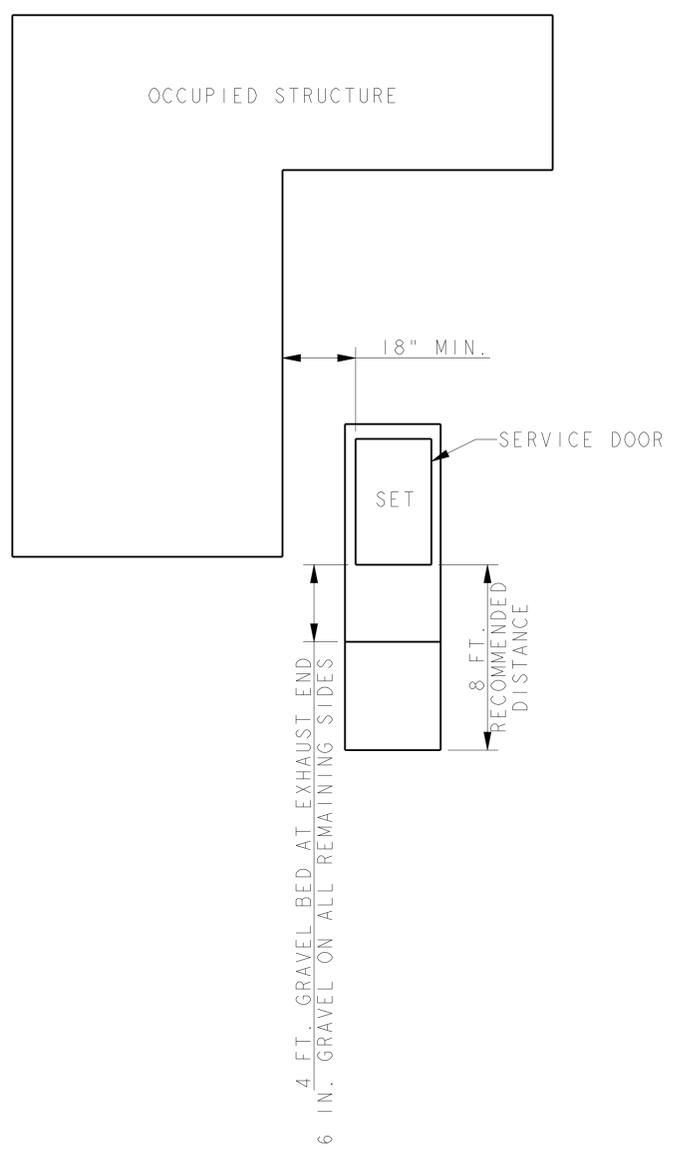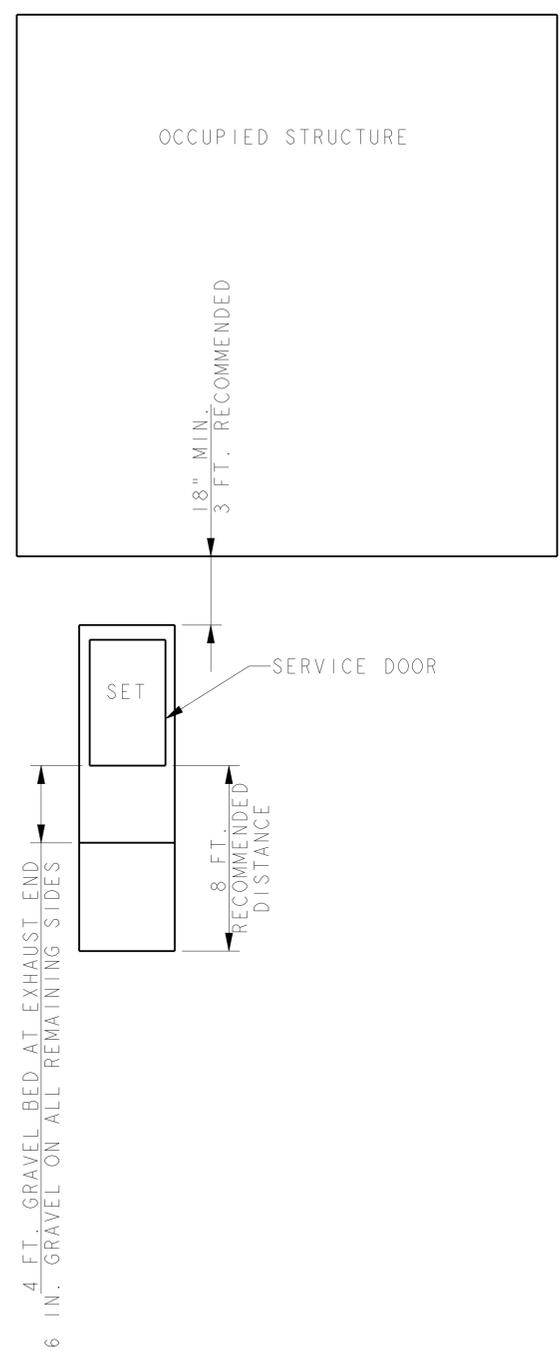

ACCEPTABLE

- 1) EXHAUST IS AIMED AWAY OR PARALLEL TO STRUCTURE.
- 2) EXHAUST IS NOT DIRECTED AT PLAY AREAS, PATIOS OR OTHER AREAS WHERE PEOPLE CONGREGATE.
- 3) THE NEAREST WINDOW, VENT, DOOR OR SIMILAR STRUCTURE OPENING IS AT LEAST 5 FEET FROM THE EXHAUST END OF THE SET.
- 4) SET HAS PROPER OFFSET FROM STRUCTURE.
- 5) WINDOWS & DOORS ON ADJACENT WALLS ARE CLOSED.
- 6) FURNACE AND OTHER SIMILAR INTAKES ARE AT LEAST 10 FEET FROM EXHAUST END OF SET.
- 7) WEED BARRIER AND 3 INCH THICK GRAVEL BASE LOCATED TO PREVENT GRASS & WEEDS FROM GROWING TOO CLOSE TO THE SET.
- 8) NO PLANTS, SHRUBS OR OTHER COMBUSTIBLES ALLOWED IN GRAVEL AREA. (MINIMUM 4 FT. FROM EXHAUST END).
- 9) SENSITIVE PLANTS, PATIO FURNITURE, ETC. ARE AT LEAST 8 FEET FROM EXHAUST END OF SET.
- 10) REFER TO OWNERS MANUAL FOR OTHER INSTALLATION CONSTRAINTS.
- 11) NO PLANTS, SHRUBS, OR OTHER COMBUSTIBLES ALLOWED WITHIN 18" OF AIR INTAKE.

NOTE:

- 1) THE REQUIRED DISTANCE FROM A STRUCTURE IS DEPENDENT ON STATE AND LOCAL CODES. NFPA 37, STANDARDS FOR THE INSTALLATION AND USE OF STATIONARY COMBUSTION ENGINES AND GAS TURBINES, STATES THIS DISTANCE SHOULD BE AT LEAST 5 FEET FROM A COMBUSTIBLE STRUCTURE.
- 2) FOR INSTALLATIONS NEAR NON-COMBUSTIBLE STRUCTURE, A MINIMUM DISTANCE OF 18" IS REQUIRED TO ENSURE PROPER GENERATOR COOLING.

14/20RESA

REV	DATE	ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL	BY	UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE:	APPROVALS	DATE
B	5-30-12	SEE SHEET 3 OF 4. [CT14992]	GFR	X.XX ±		
C	3-1-13	(A-8) NOTE 8 UPDATED; (A-3) NOTE 11 ADDED; (A-5) NOTE UPDATED; (C-8, D-1) DIM. 18" MIN. 3 FT. RECOMMENDED ADDED; (D-2, D-5, C-3) DIM. 18" MIN. ADDED [CT39030]	SVP	X.X ±		
D	4-16-13	(B-4, B-7, C-1, C-5,) "TO LAWN FURNITURE, SENSITIVE PLANTS, ETC." NOTE REMOVED; (A-2) "(MINIMUM 4 FT. FROM EXHAUST END)." ADDED; (B-7) NOTES REMOVED [CT43845]	SVP	X ANGLES ±		

KOHLER CO. METRIC PRO-E
 POWER SYSTEMS, KOHLER, WI 53044 U.S.A.
 THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.

TITLE
DIMENSION PRINT

SCALE 0.40 CAD NO. SHEET 4 of 4
 DWG NO. **ADV-8424**